


75mm Metal Fire Sleeve – 90001025

Caution! - Product has sharp edges! Wear gloves when handling.

Intumescent Fire Sleeves are lifesaving products designed to prevent the spread of fire where plastic pipes or plastic ducts penetrate fire compartment walls. It is therefore essential that they are fitted in a responsible and workmanlike manner, these devices are designed to last the lifetime of the building.

The Intumescent Fire Sleeve should be placed around the ventilation duct, positioned centrally within the partition and should be flush or protrude from each face of the wall. The plasterboard should be cut to a tight fit around the Intumescent Fire Sleeve and any gaps should be sealed with intumescent sealant.

To make installation easier, there is a sticky tab on each Rectangular unit that can be used to secure the sleeve around the pipe/duct. On the Circular units there is a small screw that holds the unit closed. This should be taken out when retrofitting the unit around the pipe/duct and can be put back in once around the pipe/duct.

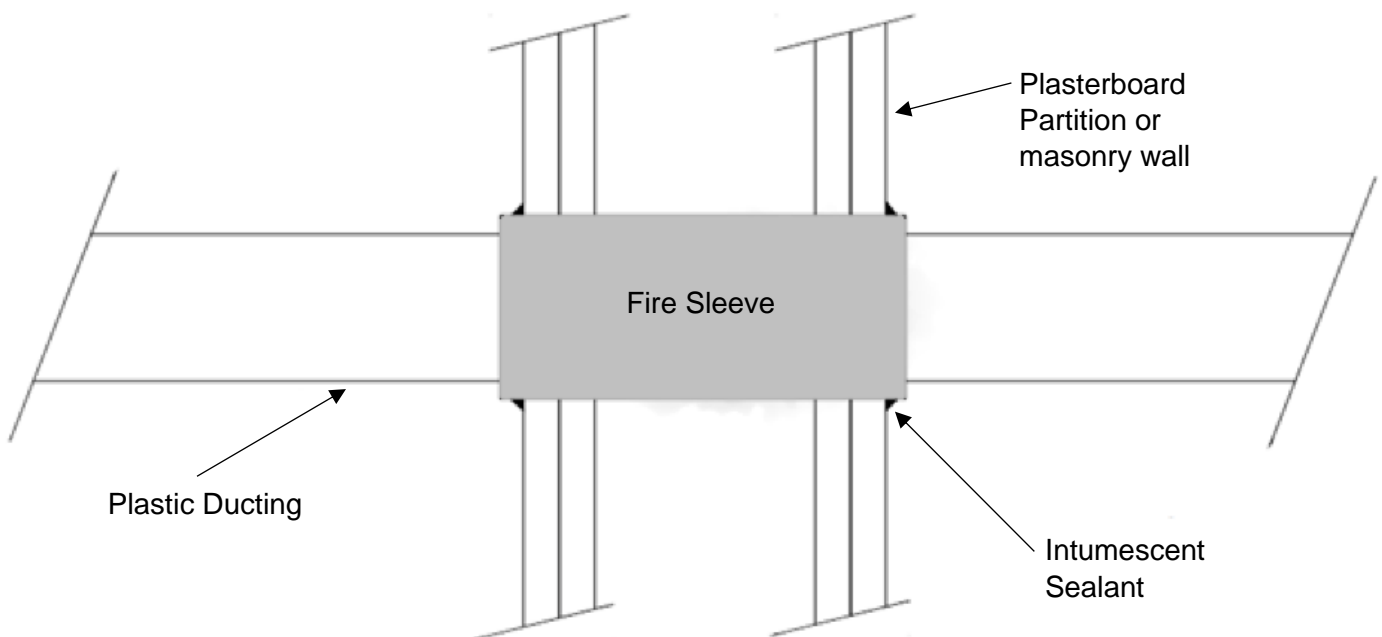

Aidelle House Lancaster Road, Cressex Business Park

High Wycombe, Buckinghamshire HP12 3QP

Telephone: 01494 525252

Fax: 01494 461073

E-mail: info@airflow.com **Website:** www.airflow.com